

**CERTIFICATE NO. 08/0302**

Aerobead Limited,  
Rathduff, Grenagh,  
Mallow,  
Co. Cork  
Tel: 00353 21 4886542  
Fax: 00353 21 4886811

## Aerobead & Aerobead Plus Cavity Wall Insulation

### Isolent de murs à double paroi Kerndämmung

The **Irish Agrément Board** is designated by Government to issue European Technical Approvals. Irish Agrément Board Certificates establish proof that the certified products are '**proper materials**' suitable for their intended use under Irish site conditions, and in accordance with the **Building Regulations 1997 to 2007**.

The **Irish Agrément Board** operates in association with the **National Standards Authority of Ireland (NSAI)** as the National Member of UEAtc.

**PRODUCT DESCRIPTION:**

This Certificate relates to Aerobead and Aerobead Plus Cavity Wall Insulation. Both bonded beads types consist of expanded polystyrene material which is injected in bead form with a binding agent into the cavity walls. They are used to reduce the thermal transmittance of completed, new or existing cavity walls with masonry inner and outer leaves.

This Certificate certifies compliance with the requirements of the Building Regulations 1997 to 2007.

**USE:**

The products are used for the thermal insulation of new or existing masonry walls up to 12 meters in height, subject to the conditions contained in Part 3 of this Certificate. They also facilitate the control of surface and interstitial condensation in walls. The current Building Regulations requirements can be met with this product, as shown in Table 1.

**MANUFACTURE AND MARKETING:**

The product is manufactured and marketed by:

Aerobead Limited,  
Grenagh,  
Mallow,  
Co. Cork.  
Tel: 00353 21 4886542  
Fax: 00353 21 4886811

## 1.1 ASSESSMENT

In the opinion of the Irish Agrément Board (IAB), Aerobead and Aerobead Plus Cavity Wall Insulation if used in accordance with this certificate, can meet the requirements of the Building Regulations 1997 to 2007 as indicated in Section 1.2 of this Agrément Certificate.

## 1.2 BUILDING REGULATIONS 1997 to 2007

### REQUIREMENT:

#### **Part D - Materials and Workmanship**

**D3** – Aerobead and Aerobead Plus Cavity Wall Insulation, as certified in this Irish Agrément Board Certificate, are manufactured from materials which are 'proper materials' fit for their intended use (see Part 4 of this Certificate).

**D1** – Aerobead and Aerobead Plus Cavity Wall Insulation used in accordance with this Irish Agrément Board Certificate, can meet the requirements for workmanship.

#### **Part B – Fire Safety**

##### **B3 – Internal Fire Spread (Structure)**

Aerobead and Aerobead Plus Cavity Wall Insulation are combustible but may be used in masonry cavity walls in buildings of every purpose group (see Section 4.1 of this Certificate).

#### **Part C – Site Preparation and Resistance to Moisture**

##### **C4 – Resistance to Weather and Ground Moisture**

Aerobead and Aerobead Plus Cavity Wall Insulation can meet the requirements, when installed in accordance with this Certificate in cavity walls constructed in compliance with the conditions indicated in Part 3. Aerobead and Aerobead Plus Cavity Wall Insulation do not absorb water by capillary action and may be used in exposures as indicated in Section 3 of this Certificate, and in situations where insulation is placed below the damp-proof course (see Section 4.2 of this Certificate).

#### **Part J – Heat Producing Appliances**

##### **J3 – Protection of Building**

In the opinion of the Irish Agrément Board, (IAB), Aerobead and Aerobead Plus Cavity Wall Insulation if used in accordance with this Certificate, can meet the requirements of Part J of the Building Regulations 1997 to 2007.

#### **Part L – Conservation of Fuel and Energy**

##### **L1 – Conservation of Fuel and Energy**

U value calculations may be based on a  $\lambda$  value = 0.04 W/mK for Aerobead and  $\lambda$  value = 0.033 W/mK for Aerobead Plus Cavity Wall Insulation. Walls using Aerobead or Aerobead Plus Cavity Wall Insulation can meet the current U-value requirements in Full Fill Cavity Wall Insulation applications depending on the cavity width (see Table 1 – Section 4.4 of this Certificate).

## 2.1 PRODUCT DESCRIPTION

Aerobead and Aerobead Plus Cavity Wall Insulation consist of an expanded polystyrene material injected in bead form with a binding agent. The binding agent is used to provide long-term stability to the insulant.

The current Building Regulation requirements can be met by installing this product (see Table 1). It should be noted that the construction of walls with cavities in excess of 110 mm requires adjustments to lintels, wall ties, cavity barriers etc. It is therefore necessary that cavity walls are adequately designed in respect of structural stability and fire safety in accordance with Parts A and B of the Building Regulations (see Section 4.4 of this Certificate).

### Product Range

Aerobead is manufactured from polystyrene granules, is white in colour and has a  $\lambda$  value of 0.04 W/mK.

Aerobead Plus is manufactured from polystyrene granules incorporating fire retardant and performance enhancing additives, is grey in colour and has a  $\lambda$  value of 0.033.

Both systems are delivered in a sealed container and pumped into the cavity with the binding agent. The target mean density for both products installed with the binding agent is 12 kg/m<sup>3</sup>. Local areas within the wall when sampled over an area of 0.5 m<sup>2</sup> may have density variations of  $\pm 2$  kg/m<sup>3</sup> for the system using the binding agent.

## 2.2 MANUFACTURE

Aerobead and Aerobead Plus Cavity Wall Insulation are specifically manufactured expanded polystyrene beads for cavity wall insulation.

## 2.3 DELIVERY, STORAGE AND MARKING

Both systems are delivered to site in a sealed bulk container marked with the IAB identification mark incorporating the number of this Certificate. The material, which has an indefinite storage life, should be kept dry.

The binding agent is also supplied to site in drums marked with the IAB identification mark incorporating the number of this Certificate and it must not be allowed to freeze.

## 2.4 INSTALLATION PROCEDURE

### 2.4.1 Site Assessment

An assessment is carried out prior to installation by a trained assessor, acting on behalf of the Manufacturer/ Approved Installer who will ascertain the suitability of the property or properties for Aerobead / Aerobead Plus Cavity Wall Insulation.

A complete assessment (including a boroscope survey) report is prepared and held at the Approved Installer's offices. Particular problems are specifically identified and any reasons for rejection of the work are noted. Quotations, tenders and invoices bear the IAB identification mark incorporating the number of this Certificate.

### 2.4.2 Site Preparation

The installing technician ensures that the property has been correctly assessed and is suitable for insulation with Aerobead / Aerobead Plus Cavity Wall Insulation. Any problems encountered during drilling which prevent compliance with this Certificate are referred to the Approved Installer before proceeding.

Essential ventilation openings such as those providing combustion air or under floor ventilation and all flues in the cavity wall are checked. If adequate sleeving or other cavity closures are not present, installation must not proceed until these openings have been sleeved or otherwise modified to prevent blockage by the insulant.

The tops of cavity walls must be closed. Cavity filling should not be done where electrical cables are not in conduits.

### 2.4.3 Approved Installers

Installation of Aerobead and Aerobead Plus Cavity Wall Insulation is carried out by Aerobead Limited or by their Approved Installers who:

- 1) Are required to meet the requirements of an initial site installation check by IAB prior to approval and are subject to the IAB Surveillance Scheme.
- 2) Are approved by Aerobead Ltd. and the IAB to install the product.
- 3) Have undertaken to comply with the Aerobead's Installation Procedure.
- 4) Are employing technicians who have been issued with appropriate identity cards by Aerobead Ltd. At least one member of each installation team must carry a card verifying this.
- 5) Are subject to supervision by Aerobead Ltd., including unannounced site inspections.

### 2.4.4 Supervision

Installation should be carried out in accordance with this Certificate, Aerobead Ltd. System Supplier Manual and the IAB Surveillance Scheme.

During installation the following simple checks can be made, as an aid to determining that the installation conforms to the certified method:

- 1) Check that the pattern of holes complies with the description given in Section 2.4.5 of this Certificate.
- 2) Check that the injection of the material takes place at each hole, to complete the filling of the cavity space.

#### **2.4.5 Procedure**

Aerobead / Aerobead Plus Cavity Wall Insulation is installed using approved equipment marked with the appropriate IAB Certificate number. The installer provides all necessary hoses, drilling tools equipment and materials for making good the walls after the installation of Aerobead / Aerobead Plus Cavity Wall Insulation.

Where a semi-detached or terraced property is to be treated, the insulation is contained by inserting a cavity barrier at the line dividing the properties. This consists of a continuous inflatable sleeve or a nylon brush. After filling, the cavity barrier is retained in the cavity and the drill holes filled. The nylon brush can also be used to prevent the blocking of under floor vents with the blown bead where these have not been previously sleeved.

After completion of the cavity assessment to confirm suitability, preparation for injection into the cavity is as follows:

Holes of 22 mm diameter are drilled in the outer or inner leaf. They are normally spaced not more than 0.7 m horizontally apart and the top row of holes in each wall is not more than 300 mm from the top of the wall. A similar series of holes is drilled below windows and obstructions and, if found to be necessary, along the lines of the roof slope at gable ends. Alternatively, a series of holes is drilled approximately 0.7 m horizontally apart and 200 mm above the highest ceiling level. A further series of holes 2.0 m apart is drilled at the middle height of a two-storey building to ensure complete fill of the cavity space. Care should be taken to ensure that these holes do not coincide with the intermediate suspended timber floor. A typical drilling pattern is shown in Figure 1.

Aerobead / Aerobead Plus Cavity Wall Insulation, together with the correct ratio of binding agent, is injected into the cavity through a flexible pipe fitted with a non-directional nozzle. The material is injected into the cavity at a consistent density and is not affected by the injection equipment. Holes beneath ground-floor windows are injected first and filling then continues upwards until a complete fill has been achieved.

After injection, the wall is made good to match the existing finish as closely as possible. All the trunked air vents are checked, e.g. those providing underfloor ventilation and combustion air for heating appliances.

In all cases flues are carefully checked on completion of the installation by means of an appropriate test (e.g. a smoke test) to ensure they are not obstructed by the insulant.

Any insulant that has been blown through the top of the cavity into the loft space is removed and any points of leakage sealed.

Prior to the commencement of the filling operation of each property it is important that the flow rates of Aerobead / Aerobead Plus Cavity Wall Insulation and the adhesive are checked to ensure that the bead and the adhesive are installed in the correct ratio. Flow rates for Aerobead / Aerobead Plus Cavity Wall Insulation and adhesive must comply with the flow rate table as detailed in the Aerobead Ltd. System Suppliers Manual.

### 3 GENERAL

Aerobead / Aerobead Plus Cavity Wall Insulation, when installed in accordance with this Certificate, is effective in reducing the 'U' value (thermal transmittance) of external masonry cavity walls, using clay or calcium silicate bricks, concrete blocks, natural stone or reconstructed stone masonry units. It is essential that such walls are designed and constructed to prevent moisture penetration and in accordance with the Building Regulations.

- 3.1** As with all cavity wall insulation, the construction detailing of the building where the insulation is to be installed should comply with good practice. Certification will only relate to buildings which conform to the design conditions set out here and to buildings where the Certificate Holder or Registered Installer has carried out a complete assessment, including a boroscope survey, and has given written approval for the use of the product.
- 3.2** Cavity walls with the outer leaf constructed using unrendered (fair-faced) block work are not suitable for full-fill cavity wall insulation. They are therefore not covered by this Certificate.
- 3.3** There are separate procedures for assessing suitability of existing and new buildings for Aerobead and Aerobead Plus Cavity Wall Insulation.
- 3.4** Existing buildings should be assessed in accordance with BS 8208:Part 1:1985 *Guide for the assessment of suitability of external cavity walls, for filling with thermal insulants – Existing traditional cavity construction*. Existing Buildings are defined as buildings of at least three years old.
- 3.5** For new buildings, the designer selects a construction appropriate to the local wind-driven rain index, paying due regard to the design, detailing, workmanship and materials to be used.
- 3.6** Buildings subject to the relevant requirements of the Building Regulations 1997 to 2007 should be constructed in accordance with IS 325:Part 1:1986 *Code of Practice for the use of Masonry - Structural Use of Unreinforced Masonry*, and IS 325:Part 2:1995 *Code of Practice for the use of masonry - Masonry construction*. Where reinforced masonry is involved, the design should be in accordance with BS 5628:Part 2:2000 *Code of practice for use of masonry, Structural use of reinforced and prestressed masonry*.

The relevant recommendations of Section 3 of BS 5390:1976 *Code of practice for stone masonry* should be followed where the wall incorporates stone or cast stone. In the case of fair faced brickwork only tool flush joint brickwork is acceptable, subject to the following conditions:

- The minimum cavity width for existing buildings is 40 mm;
- There are no signs of dampness on the inner face of the cavity other than those caused solely by condensation.

- 3.7** Any defects recorded which may affect the performance of the installed insulation system must be rectified to the satisfaction of the Approved Installer before work commences.
- 3.8** In cavities where electric cables can come into contact with expanded polystyrene, in accordance with good construction practice all PVC sheathed electric cables should be run through ducting.
- 3.9** Aerobead and Aerobead Plus Cavity Wall Insulation is capable of contributing to or exceeding the 'U' value of 0.27W/m<sup>2</sup>K required in the Building Regulations (See Table 1).
- 3.10 Assessment of Exposure Zones**  
During the assessment phase of a building for cavity wall insulation the topography factor of the site must be taken into account in all exposure zones. The topography factor takes account of local features such as hills, cliffs, escarpments or ridges where dwellings are located, which can significantly affect the wind speed in their vicinity. It should be derived for each wind direction considered. Reference should be made to BS 8104:1992 *Code of practice for assessing exposure of walls to wind driven rain* for guidance in this regard. Appendix C makes reference to the topography factor which details the method of calculation of the wind driven rain index for exposed sites in all zones. It is only after all relevant factors are considered and calculations carried out can a true assessment of the work content for a particular building be arrived at. Figure 2 identifies the two exposure zones for wind driven rain appropriate to this certificate as follows:

#### 3.10.1 Normal Exposure

Normal exposure to wind-driven rain applies in districts where the driving rain index is less than 5m<sup>2</sup>/sec/year however, some areas may require modification to calculations in order to cater for particular individual sites where the topography of a site warrants it (see Figure 2). Appendix C of BS 8104:1992 should be consulted.

In **normal exposure** areas the types of outer leaf masonry finishes and zones where Aerobead and Aerobead Plus Cavity Wall Insulation are suitable are as follows:

- Impervious cladding and rendered walls with a minimum cavity width of 90 mm and up to 12m in height, and
- Fair faced unrendered brickwork with tooled flush joints up to two storeys in height with a minimum cavity width of 90mm and up to three storeys in height with a minimum cavity width of 140mm.

### 3.10.2 Severe Exposure

Severe exposure to wind-driven rain applies in districts where the driving rain index is  $5\text{m}^2/\text{sec}/\text{year}$  or more (see Figure 2). During the pre-insulation survey of any particular building, due regard to the exposure zones and type of masonry construction must be assessed prior to the commencement of the installation process.

In **severe exposure** areas the type of outer leaf masonry finish where Aerobead and Aerobead Plus Cavity Wall Insulation System are suitable is:

- Impervious cladding and rendered walls with a minimum cavity width of 90mm and up to 12m in height.

Unrendered brickwork is not suitable for full-fill cavity wall insulation in the severe exposure zones.


Weep holes in accordance with good construction practice must be provided at the base of brick faced cavity walls at 450mm centres and over lintels.

**3.11** In both new and existing buildings, whenever practicable, all of the cavity space from ground level to roof or gable copings must be filled. Partial filling is only allowed in the following situations:

- 1) When separately insulating semi-detached or terraced properties. The type of cavity barrier used for this purpose must be as defined in Section 2.4.5 of this Certificate.
- 2) Up to the underside of a horizontal boundary, other than the roof, where that boundary is protected by a cavity tray or similar waterproof barrier which must not be distorted or damaged by the installation process.
- 3) Where filling is carried out above a horizontal boundary where that boundary is protected by a cavity tray or similar waterproof barrier which must not be distorted or damaged by the installation process.
- 4) When treating properties where the wall to be insulated is below a waterproof cladding (e.g. tile hung) and this cladding either extends up to the roof or is protected at the top by other means (e.g. window sills with adequate waterproof barrier system).
- 5) Where it is established that the roof void will not be an occupied space, and where the attic insulation is provided at ceiling level, partial filling of the gable apex (i.e. limiting the fill to at least 200mm above ceiling level insulation) may be permitted provided the top of the gable apex is adequately protected by the roof and its overhang and where the attic space is adequately ventilated.

### 3.12 Structures

The spacing of wall ties should be installed in accordance with Table 9a of IS 325:Part 2:1995. When the cavity width exceeds 110mm the wall and foundations should be designed by a Structural Engineer in accordance with IS 325:Part 1:1986.

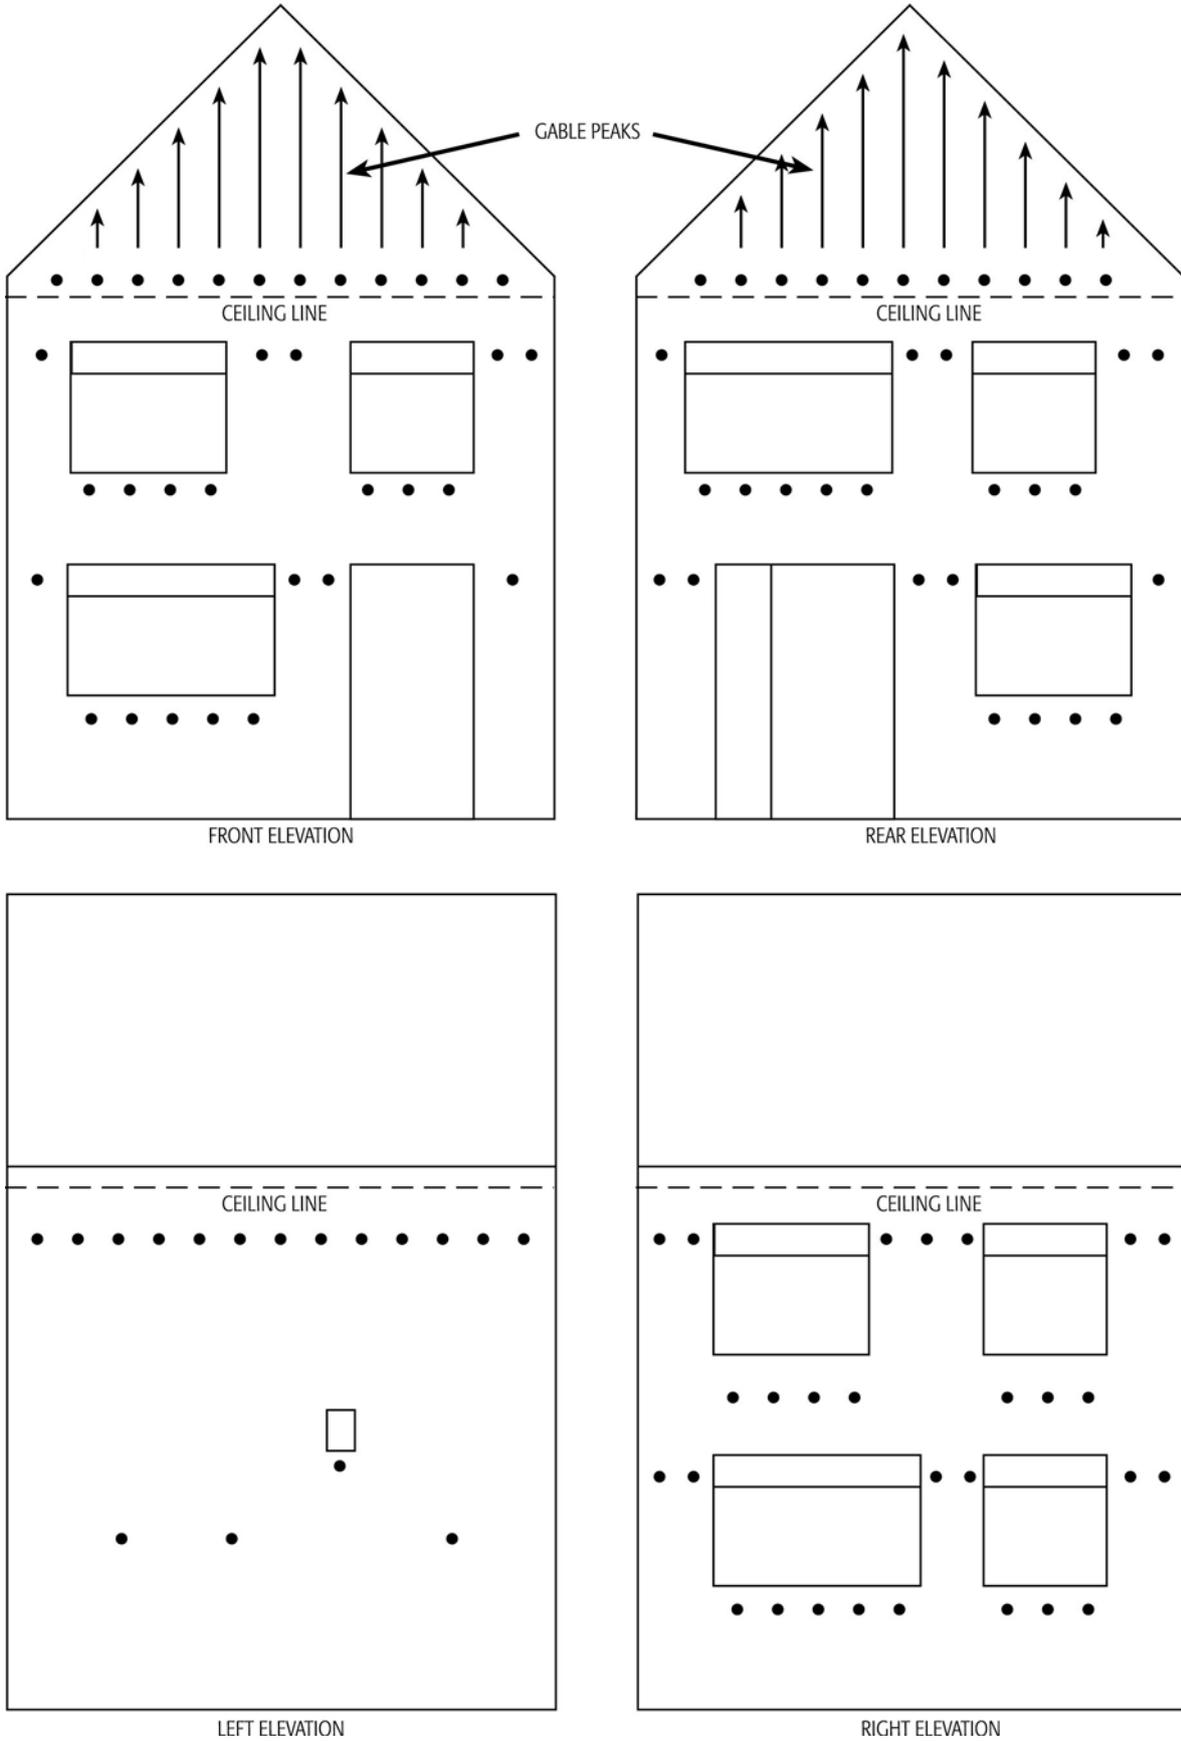

**Figure 1: Typical Aerobead / Aerobead Plus Hole Drilling Pattern in a Detached Dwelling**

## Driving Rain Map

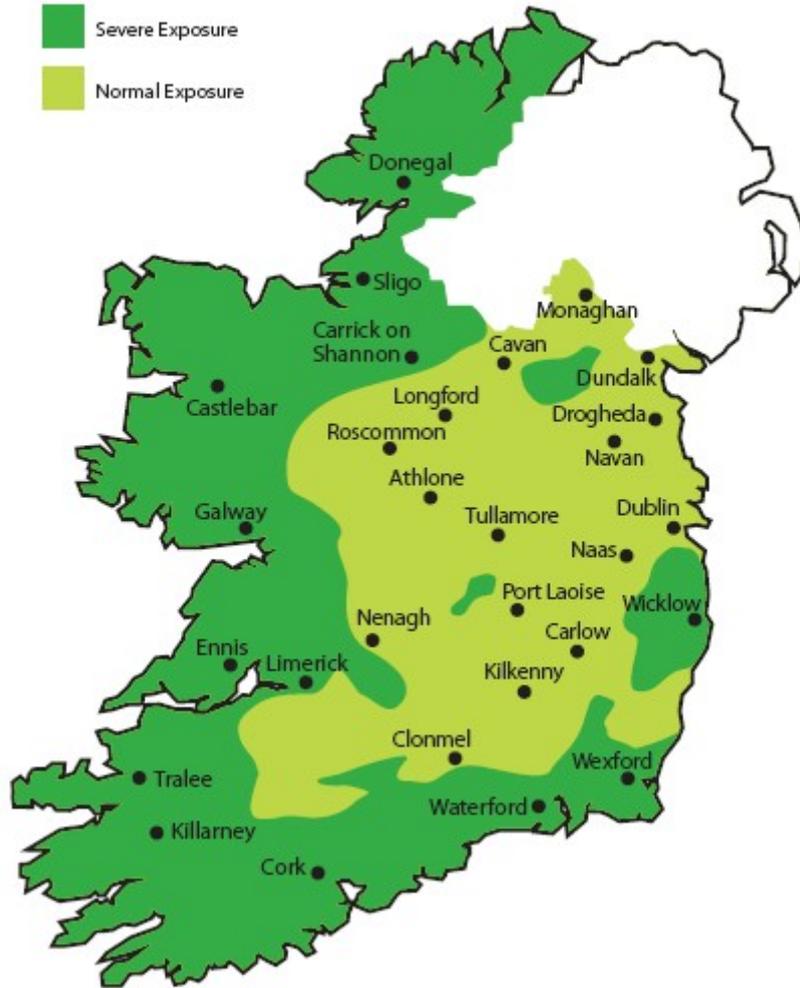


Figure 2: Driving Rain Map

#### 4.1 BEHAVIOUR IN FIRE

**4.1.1** The use of the product does not prejudice the fire resistance properties of the wall. It is unlikely to become ignited within the cavity when used in the context of this Certificate. If fire does penetrate into the cavity, the amount of air present will be insufficient to support combustion. However, the directions contained in this Certificate relating to the sealing of an uncapped cavity and removing insulant present in the loft space after installation must be carefully followed.

When using this product, the requirements of the Building Regulations 1997 to 2007 relating to fire spread in cavity walls can be met in most purpose groups without the need for cavity barriers provided the walls are constructed in accordance with the following provisions of the TGD to Part B Fire:

1. The wall must consist of masonry inner and outer leaves, each at least 75 mm thick.
2. The cavity must be closed at the top of the wall and at the top of any opening.
3. In addition to the product only the following combustible materials shall be placed in, or exposed to, the cavity:
  - a) timber lintel, window or door frame, or end of timber joist
  - b) pipe, conduit
  - c) dpc flashing closer or wall tie
  - d) domestic meter cupboard, provided that:
    - there are not more than two cupboards to a dwelling.
    - the opening in the outer leaf is not more than 800 mm by 500 mm for each cupboard, and
    - the inner leaf is not penetrated except by a fire-stopped sleeve not more than 80 mm by 80 mm.
  - e) thermal insulating material
  - f) in respect of purpose groups 3 – 8 the cavities are sub-divided so that the distance between cavity barriers does not exceed the dimensions given in paragraph 3.3 of the TGD to Part B

**4.1.2** For buildings constructed in accordance with the Building Regulations 1997 to 2007 the product may be used in buildings of every purpose group.

**4.1.3** As Aerobead and Aerobead Plus Cavity Wall Insulation material is manufactured without the use of 'CFCs', or similar gases, there is no release of such gas on burning.

#### 4.1.4 Protection of Buildings

Combustible wall insulation material should be separated by solid non-combustible material not less than 200mm thick, from any heating appliance or from any flue pipe or opening to a heating appliance; alternatively it should be separated by 40mm from the outer surface of a masonry chimney. Particular details are given in Diagrams 2-8 of the TGD Part J Building Regulation 1997 to 2007. For factory made insulated chimneys, separation between this product and the external surface of the chimney shall be determined in accordance with Clause 2.17, of Part J of the Building Regulations 1997 to 2007.

#### 4.2 LIQUID WATER PENETRATION

- 4.2.1** Test data obtained by the IAB confirms that a masonry wall incorporating Aerobead / Aerobead Plus Cavity Wall Insulation and built to the requirements of IS 325:Part 1:1986, will not transmit water to the inner leaf.
- 4.2.2** Test data obtained by the IAB also demonstrates that Aerobead and Aerobead Plus Cavity Wall Insulation material does not absorb water by capillary action. Water which penetrates the outer leaf of the wall will drain down the cavity face of the outer leaf. When the product is used in situations where it bridges the dpc in walls, dampness from the ground will not pass through, provided the cavity is taken down to at least 150 mm below the level of the lowest dpc.
- 4.2.3** Aerobead and Aerobead Plus Cavity Wall Insulation System, when used in accordance with this Certificate, present no significant risk of water penetration.

#### 4.3 WATER VAPOUR PENETRATION AND CONDENSATION RISK

Aerobead / Aerobead Plus Cavity Wall Insulation is not a water vapour barrier.

#### 4.4 THERMAL INSULATION

The thermal conductivity ' $\lambda$ ' value' of the Aerobead Cavity Wall Insulation material may be taken as 0.04 W/mK for the purpose of U value calculations. The thermal conductivity ' $\lambda$ ' value' of the Aerobead Plus Cavity Wall Insulation material may be taken as 0.033 W/mK for the purpose of U value calculations.

The required maximum U-values for external walls can be obtained in typical cavity wall constructions as indicated in Table 1.

#### 4.5 DURABILITY

Aerobead and Aerobead Plus Cavity Wall Insulation are rot-proof, water repellent and durable. When installed in accordance with this certificate they are sufficiently stable to prevent settlement and will remain effective as an insulant for the life of the building when installed in accordance with this Certificate.

#### 4.6 TESTS AND ASSESSMENTS WERE CARRIED OUT TO DETERMINE THE FOLLOWING:

- efficiency of fill using specified equipment and drilling pattern
- density of fill
- water resistance of filled cavity
- water uptake
- thermal conductivity

#### 4.7 OTHER INVESTIGATIONS

- Existing data on product properties in relation to fire, toxicity, environmental impact and the effect on structural stability and durability were assessed. The absence of chloro-fluorocarbon gases 'CFCs' was established by test.
- The manufacturing process was examined including the methods adopted for quality control, and details were obtained of the quality and composition of the materials used.
- A site visit was conducted to assess the practicability of installation.
- Driving rain resistance was assessed.
- A condensation risk analysis was performed.

**Table 1: External Walls – Estimated U Values W/(m<sup>2</sup>K)**

Aerobead - 0.04 W/mK																	
Brick 1700 kg/m <sup>3</sup> / Block 2000 kg/m <sup>3</sup> / Plaster																	
mm	50	55	60	65	70	75	80	85	90	95	100	105	110	115	120	125	130
U	0.59	0.55	0.51	0.48	0.45	0.43	0.41	0.39	0.37	0.35	0.34	0.33	0.31	0.30	0.29	0.28	0.27
Block 2000 kg/m <sup>3</sup> (Rendered) / Block 2000 kg/m <sup>3</sup>																	
mm	50	55	60	65	70	75	80	85	90	95	100	105	110	115	120	125	130
U	0.60	0.56	0.52	0.49	0.46	0.43	0.41	0.39	0.37	0.36	0.34	0.33	0.31	0.30	0.29	0.28	0.27
Aerobead Plus - 0.033 W/mK																	
Brick 1700 kg/m <sup>3</sup> / Block 2000 kg/m <sup>3</sup> / Plaster																	
mm	50	55	60	65	70	75	80	85	90	95	100	105	110	115	120	125	130
U	0.51	0.47	0.44	0.41	0.39	0.37	0.35	0.33	0.31	0.30	0.29	0.27	0.26	0.25	0.24	0.24	0.23
Block 2000 kg/m <sup>3</sup> (Rendered) / Block 2000 kg/m <sup>3</sup>																	
mm	50	55	60	65	70	75	80	85	90	95	100	105	110	115	120	125	130
U	0.52	0.48	0.45	0.42	0.39	0.37	0.35	0.33	0.32	0.30	0.29	0.28	0.27	0.26	0.25	0.24	0.23

The construction of walls with cavities in excess of 110mm wide requires adjustments to lintels, wall ties, cavity barriers, etc. It is therefore necessary that cavity walls are adequately designed in respect of structural stability and fire safety in accordance with Parts A and B of the Building Regulations. For Table 1 it is assumed that cavity walls containing full-fill bonded bead will be constructed in accordance with the requirements of the 1997 to 2007 Building Regulations.


- 5.1** National Standards Authority of Ireland ("NSAI") following consultation with the Irish Agrément Board ("IAB") has assessed the performance and method of installation of the product/process and the quality of the materials used in its manufacture and certifies the product/process to be fit for the use for which it is certified provided that it is manufactured, installed, used and maintained in accordance with the descriptions and specifications set out in this Certificate and in accordance with the manufacturer's instructions and usual trade practice. This Certificate shall remain valid for five years from date of issue so long as:
- (a) the specification of the product is unchanged.
  - (b) the Building Regulations 1997 to 2007 and any other regulation or standard applicable to the product/process, its use or installation remains unchanged.
  - (c) the product continues to be assessed for the quality of its manufacture and marking by NSAI.
  - (d) no new information becomes available which in the opinion of the NSAI, would preclude the granting of the Certificate.
  - (e) the product or process continues to be manufactured, installed, used and maintained in accordance with the description, specifications and safety recommendations set out in this certificate.
  - (f) the registration and/or surveillance fees due to IAB are paid.
- 5.2** The IAB mark and certification number may only be used on or in relation to product/processes in respect of which a valid Certificate exists. If the Certificate becomes invalid the Certificate holder must not use the IAB mark and certification number and must remove them from the products already marked.
- 5.3** In granting Certification, the NSAI makes no representation as to;
- (a) the absence or presence of patent rights subsisting in the product/process; or
  - (b) the legal right of the Certificate holder to market, install or maintain the product/process; or
  - (c) whether individual products have been manufactured or installed by the Certificate holder in accordance with the descriptions and specifications set out in this Certificate.
- 5.4** This Certificate does not comprise installation instructions and does not replace the manufacturer's directions or any professional or trade advice relating to use and installation which may be appropriate.
- 5.5** Any recommendations contained in this Certificate relating to the safe use of the certified product/process are preconditions to the validity of the Certificate. However the NSAI does not certify that the manufacture or installation of the certified product or process in accordance with the descriptions and specifications set out in this Certificate will satisfy the requirements of the Safety, Health and Welfare at Work Act 2005, or of any other current or future common law duty of care owed by the manufacturer or by the Certificate holder.
- 5.6** The NSAI is not responsible to any person or body for loss or damage including personal injury arising as a direct or indirect result of the use of this product or process.
- 5.7** Where reference is made in this Certificate to any Act of the Oireachtas, Regulation made thereunder, Statutory Instrument, Code of Practice, National Standards, manufacturer's instructions, or similar publication, it shall be construed as reference to such publication in the form in which it is in force at the date of this Certification.

The Irish Agrément Board

This Certificate No. **08/0302** is accordingly granted by the NSAI to **Aerobead Ltd.** on behalf of The Irish Agrément Board.

Date of Issue: **February 2008**

Signed



**Seán Balfe**  
**Director of the Irish Agrément Board**

Readers may check that the status of this Certificate has not changed by contacting the Irish Agrément Board, NSAI, Glasnevin, Dublin 9, Ireland. Telephone: (01) 807 3800. Fax: (01) 807 3842. [www.n sai.ie](http://www.n sai.ie)